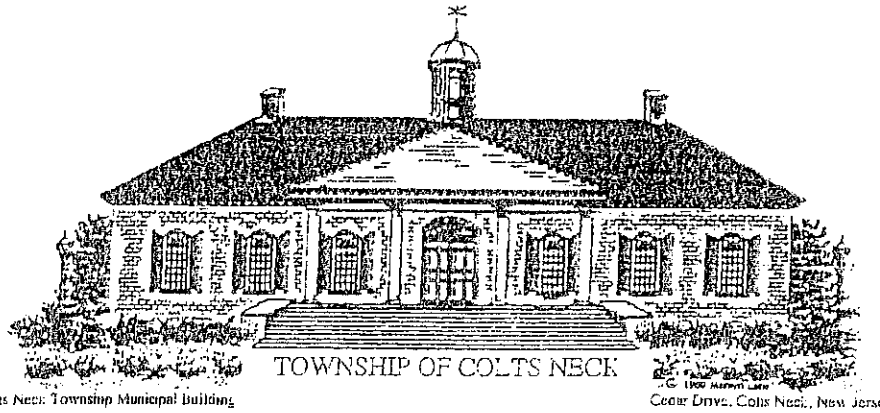


124 Cedar Drive
Colts Neck, New Jersey 07722

BUILDING DEPARTMENT

Phone: (732) 409-7134
Fax: (732) 462-8460

Requirements for Electric-Plan Review of optional standby systems (generator) with automatic transfer equipment

Block: _____ Lot: _____ Address: _____

Provide:

1. Calculate load to be serviced by generator per NJPA 70 article 220 or other approved means(actual load) in kilowatts _____KW
2. Kilowatts of load management/load shed if installed _____KW
3. Capacity of generator in kilowatts _____KW
4. Specifications for generator and transfer switches
5. Wiring diagram with wiring method, wire sizes, ratings of disconnects/transfer switches and method of grounding
6. Manufacturers specification for generator and transfer switches

Note: NEC 2008 article 702.5(B)(2): The standby source shall be capable of supplying the full load that is transferred by the automatic transfer equipment.

Draw sketch here and don't forget to sign and seal drawings